



3636 PULLBOX - TR



TOP VIEW

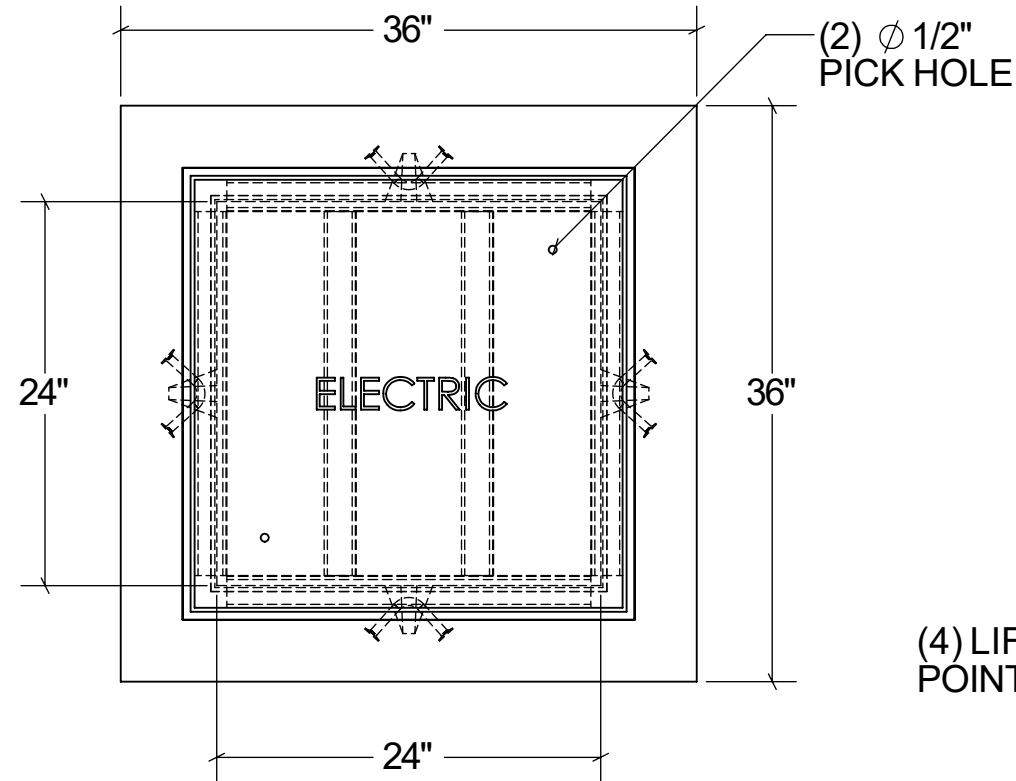

END VIEW

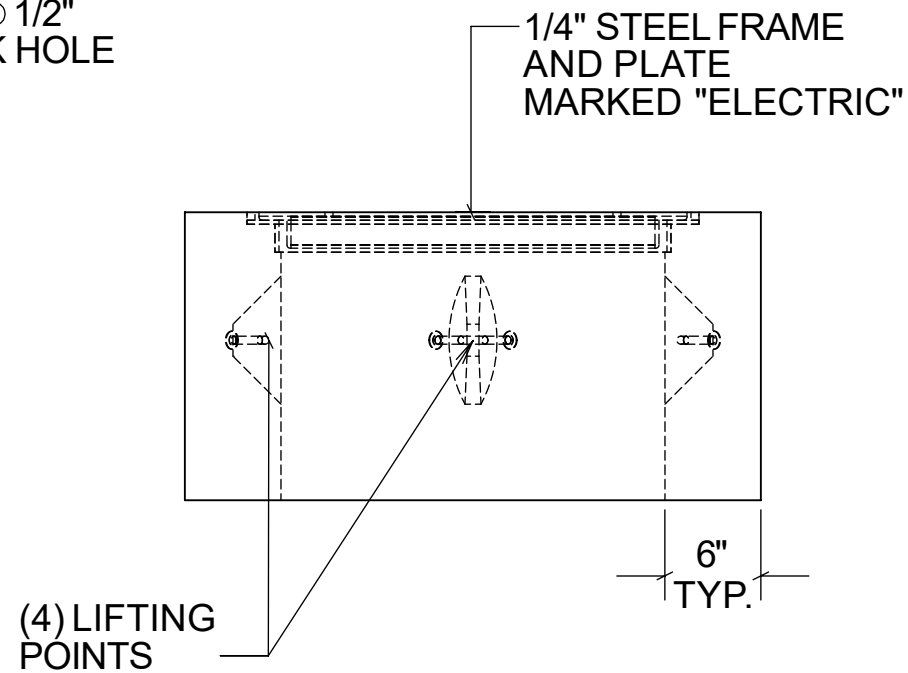

SECTION VIEW

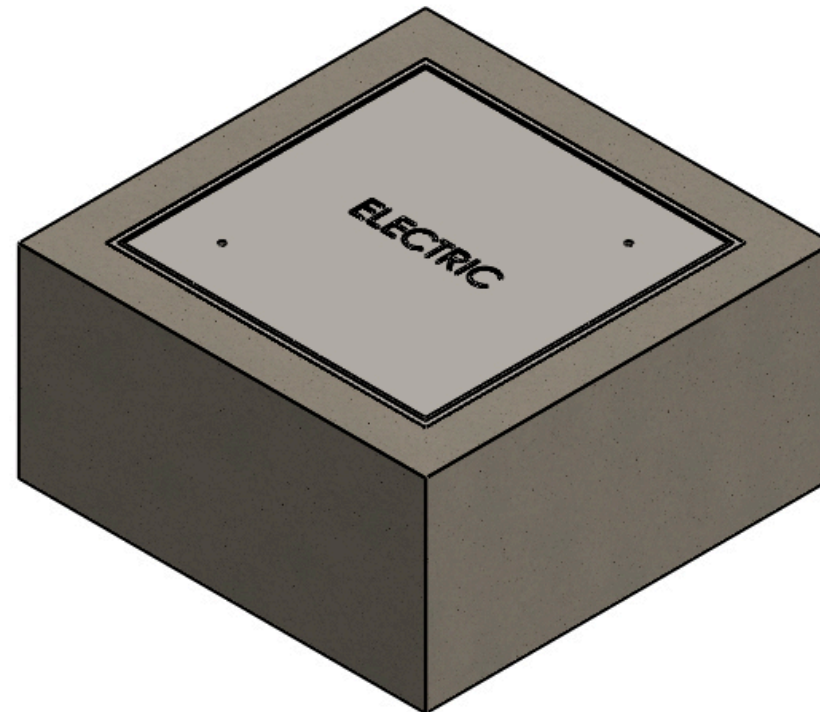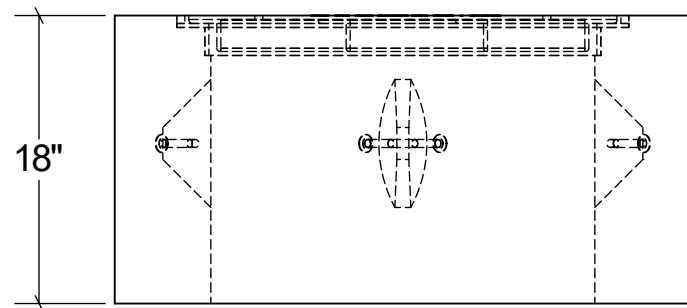


STRUCTURAL NOTES:

1. ALL CONCRETESHALL BE PLACED IN A SINGLE CONTINUOUS OPERATION (MONOLITHIC POUR).
2. CONCRETESHALL HAVE A MINIMUM 28-DAY COMPRESSIVE STRENGTH OF 4000 PSI CONCRETEAGGREGATE SHALL CONFORM TO ASTM C33.
3. CEMENT SHALL CONFORM TO ASTM C150, TYPE I, II, OR III.
4. MINIMUM REINFORCEMENTTO BE: GRADE 70, 0.25" X 0.25" X 4" X 4" W.W.F.
5. H-10 LOAD RATED
6. 1/4" MILL FINISHCOVERTO HAVE (2) 2'X2"X1/4" STIFFENERS.
7. (2) 1/2" PICK HOLES CATTY-CORNER ON COVER.
8. 2"X2"X1/4" ANGLE FRAME TO HAVE 1/2"X2" STUDS FOR CASTIN INTO CONCRETE AROUND PERIMETER OF FRAME.

INSTALLATION NOTES:

1. LOCATE BOX OUT OF WHEEL PATH IF POSSIBLE.
2. NO PARKING ON TOP OF BOX
3. WALLS MUST BE FULLY SUPPORTEDBY BLOCKING TO PREVENT PUNCH THROUGH.
4. SOIL SHOULD BE COMPACTED TO A DEPTH OF 6" BELOW WALL SUPPORTBLOCKING.

DRAWN: 03/06/23	WEIGHT: 1125 LBS	SCALE: VARIES
MATERIAL: 4,000 PSI CONCRETE	FINISH: FORM FINISH	DIMENSIONS ARE IN FEET & INCHES TOLERANCES: ± 4-IN.

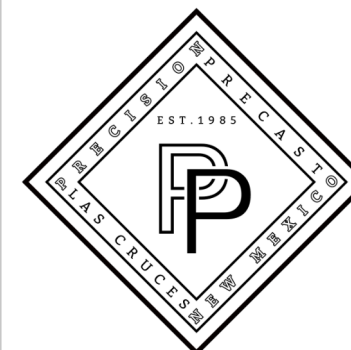

PRECISION PRECAST
575-382-0501
SALES@PRECISIONPRECAST.CO
WWW.PRECISIONPRECAST.CO

PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF LECO INDUSTRIES INC DBA PRECISION PRECAST. ANY REPRODUCTION PART OR AS A WHOLE WITHOUT WRITTEN PERMISSION OF LECO INDUSTRIES, INC DBA PRECISION PRECAST IS PROHIBITED.